
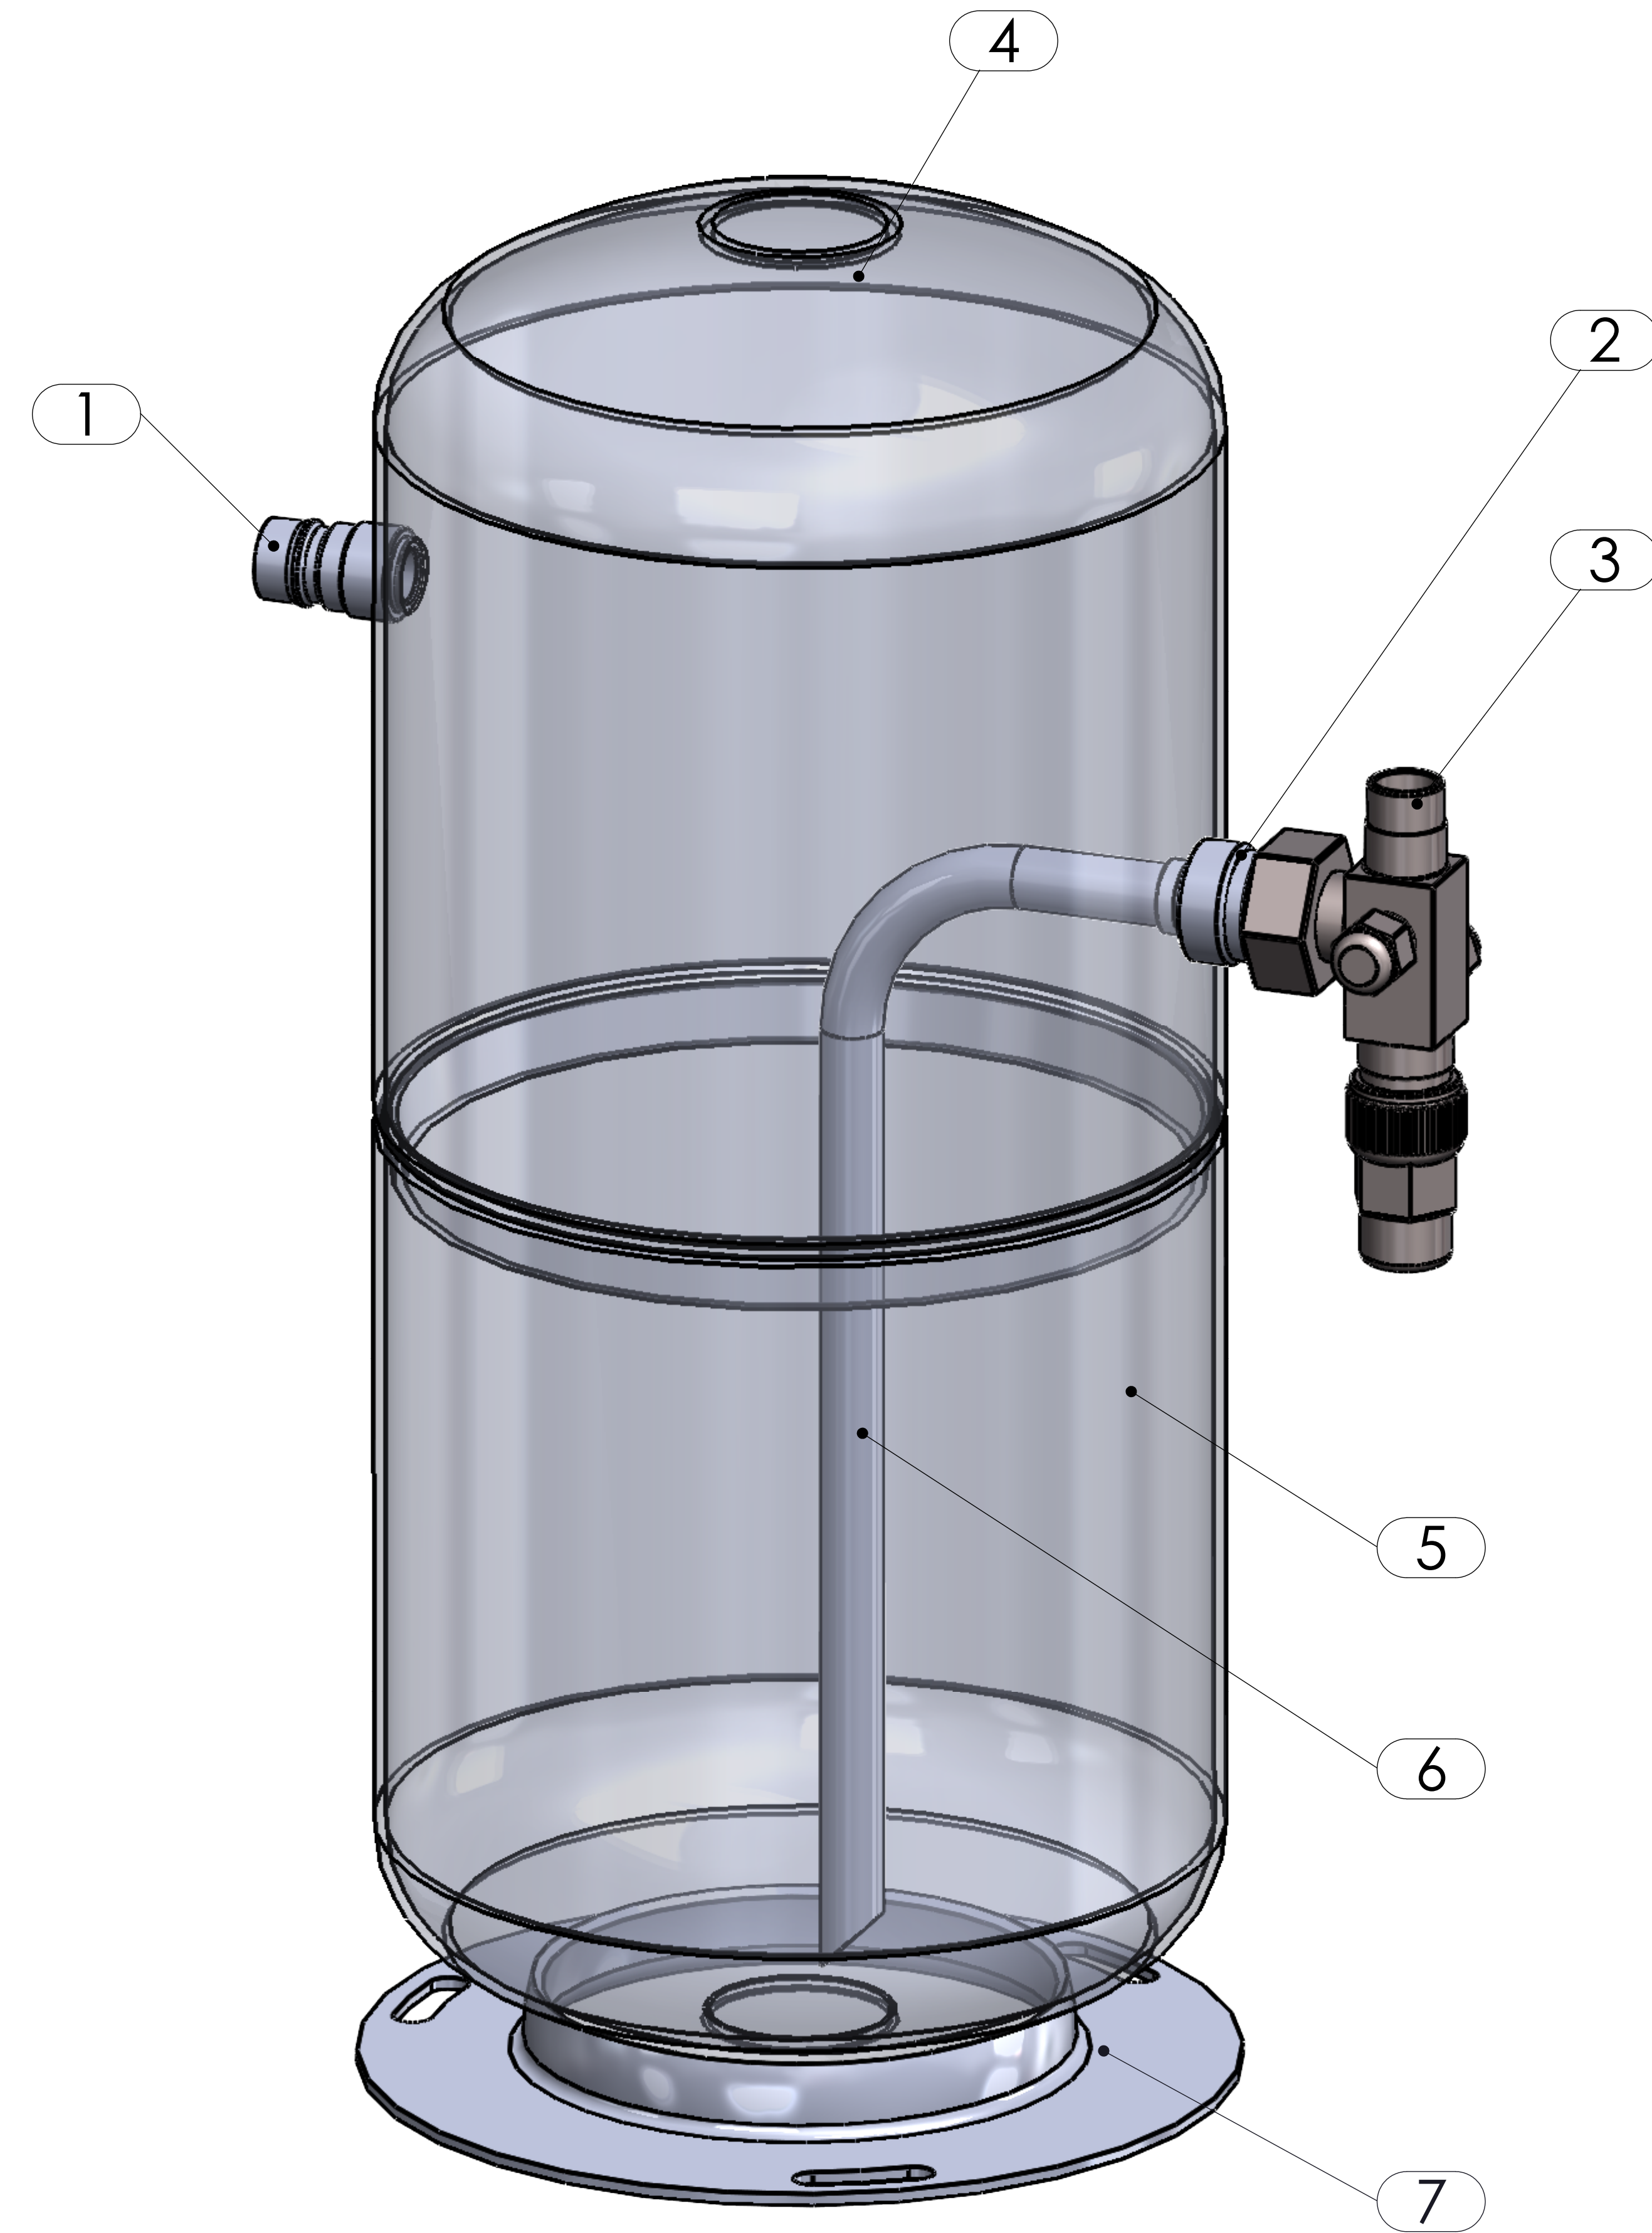


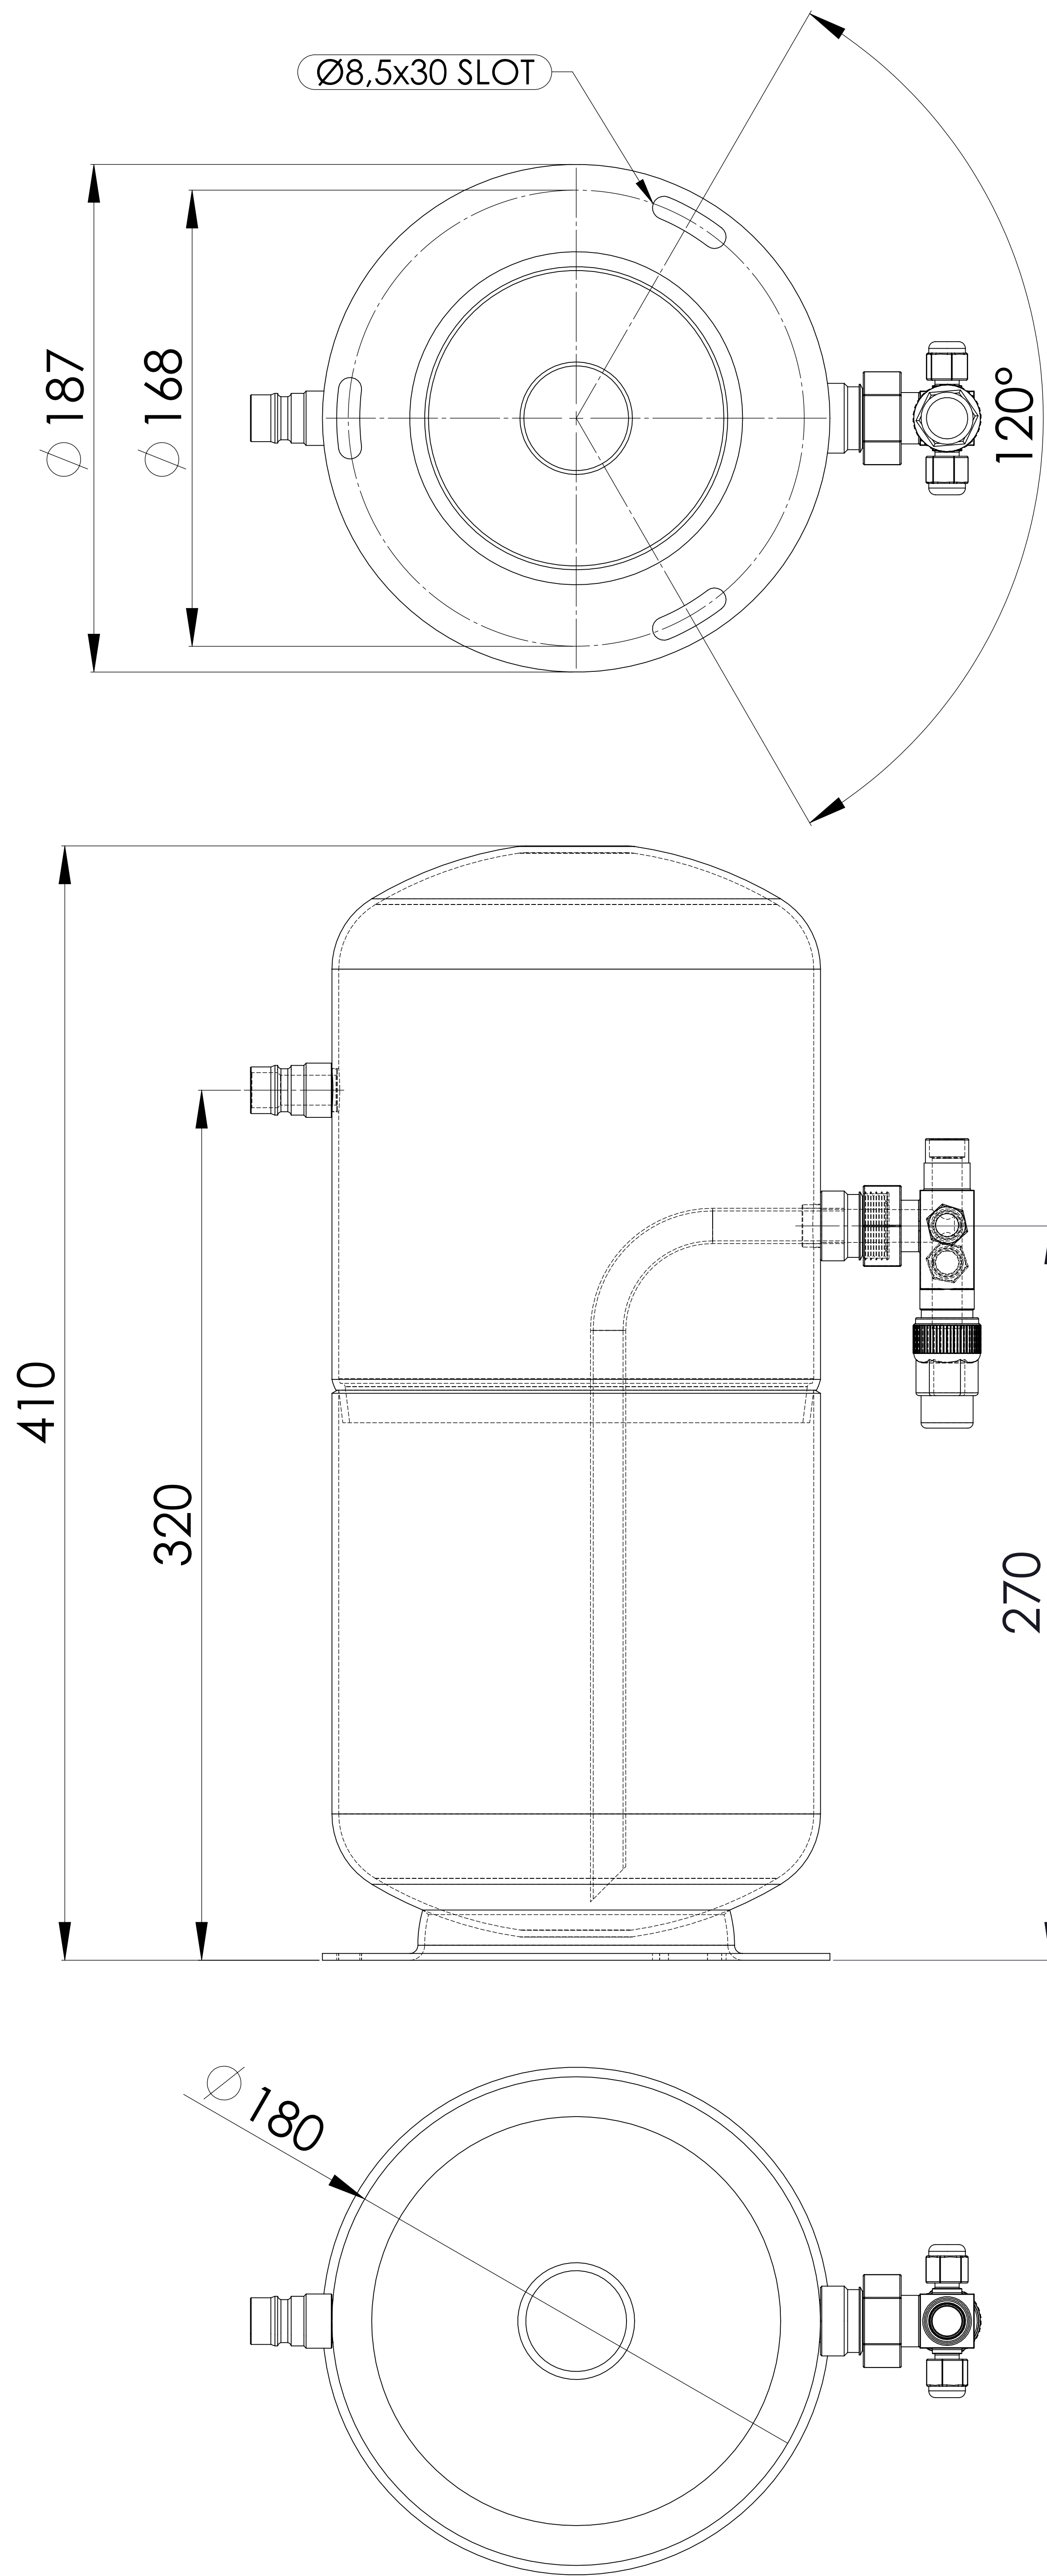

No	Assembly Codes	Qty
1	M005.000024	1

GÜVEN SOĞUTMA
ÜNİTELERİ SAN. VE TİC. A.Ş.
Add.: Hastane Mah. Hadimköy İstanbul Cd. No:78/1
34555, Arnavutköy, İstanbul, TURKEY
Tel: +90 212 771 51 12 - 771 51 13
Fax: +90 212 771 51 10
www.gvn.com.tr

SINCE 1985

GVN

REFRIGERATION COMPONENTS

GVN STANDART PRODUCT	Customer
VERTICAL LIQUID RECEIVER	Product
VLR.A.33b.09.B3.C3	Code
	Customer Code

DESIGN DATA	
Capacity [Lt.]	9 Lt.
Design Pressure [PS]	33 Bar
Pneumatic Test Pressure [PT]	36 Bar
Hydraulic Test Pressure	48 Bar
Design Temperature [TS]	Min.-20C / Max.+130C
Cooler Fluid Type	HFC-CFC-HCFC
Fluid Group	2
Category	CAT II / D1
Desing Calculation	EN 14276-1/EN 13445-3
Welded Joint Efficiency	0.85
Material Group (Shell / Head)	1.2
Testing Group	3b
Corrasion Allowance	0,5 mm
Ndt	10%
Packaging Size & Weight	00*00*00 & 00 Kg.
Drawed By	Ö.TÜRKER
Approved By	D.GÜL
Date	20.06.2022
Color	RAL 5009

MATERIAL DATA					
No	Connection	Model	Code	Material	Qty
1	Inlet Connection	ODS 1/2" H:30	106.060.B03.INL.T30	ST44-E275	1
2	Outlet Connection	ROT. 1" H:25	106.060.A02.001.T25	E275-EN10297-1	1
3	Outlet Valve	RV.45b-1/2	C3.RV.45B.01.1-2		1
4	Deep Drawn	Ø180x2,5 H:201	203.090.001.001.001	EN 10111-DD-13	1
5	Deep Drawn	Ø180x2,5 H:201	103.090.002.001.000	EN 10111-DD-13	1
6	Pipe	Ø13x1	204.A13.010.000.270	EN10297-1 E235	1
7	Skirt With	Ø187x18,50 f:2,50	105.004.187.001.001	DD13-EN10111	1

GENERAL NOTES	
-Max. allowable operating pressure [PS] according to the temperature range; 1)Allowable operating temperature : min. -10C° / max. +100C° PS1 = 33 Bar 2)Allowable operating temperature : min. -10C° / max. -40C° PS2 = 24 Bar -Unless otherwise specified dimensions in MM -Unless otherwise specified do not scale -Unless otherwise specified tube must be clean&free form burrs inside&outside&suitable for soldering -Unless otherwise specified do not scale indicated thickness are min. after forming or machining -Unless otherwise specified dimension tolerances according to EN 113445-4	

REVISIONS			
No	Details Of Change	Date	By
01	33 BAR YAPILDI	11.07.2024	M.AKKAŞ
02	STANDART TEKNİK RESİM ÖLÇ YAPILDI	17.09.2024	M.AKKAŞ
03			

RELATED DRAWINGS	
No	Description
01	
02	

ISO 9001 2015 CERTIFIED

CE PED 2014 / 68 / EU

EAC CERTIFICATE

We reserve all rights in this document and in the information contained therein.
Reproduction use or disclosure to third parties without express authority is strictly forbidden.